



3rd Floor East (E-VAV) Space Temperature vs. Heating and Cooling Setpoints
 (Setpoints maintained only during occupied schedule 8am -6pm M-F)

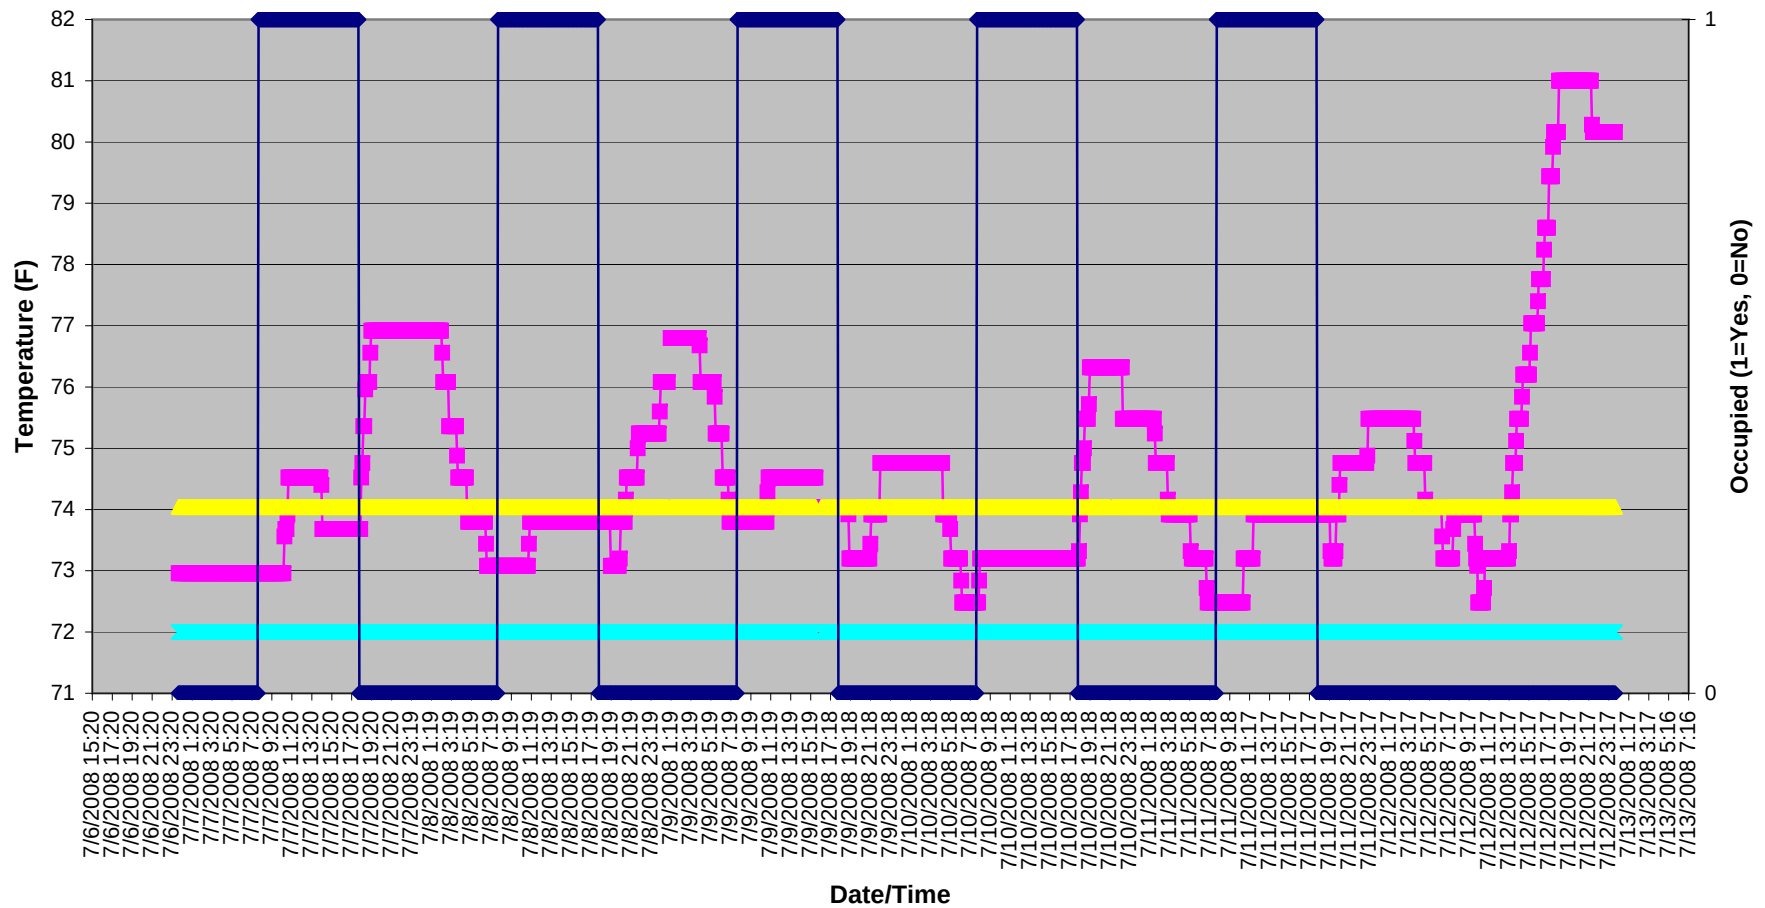

—■ E3RmTemp.PointValue —▲ E3CoolOccSpt.PointValue
—× E3HeatOccSpt.PointValue —◆ Occupied (1=yes, 0=No)

EF-2 (SF-6) Relative Humidity Monitoring

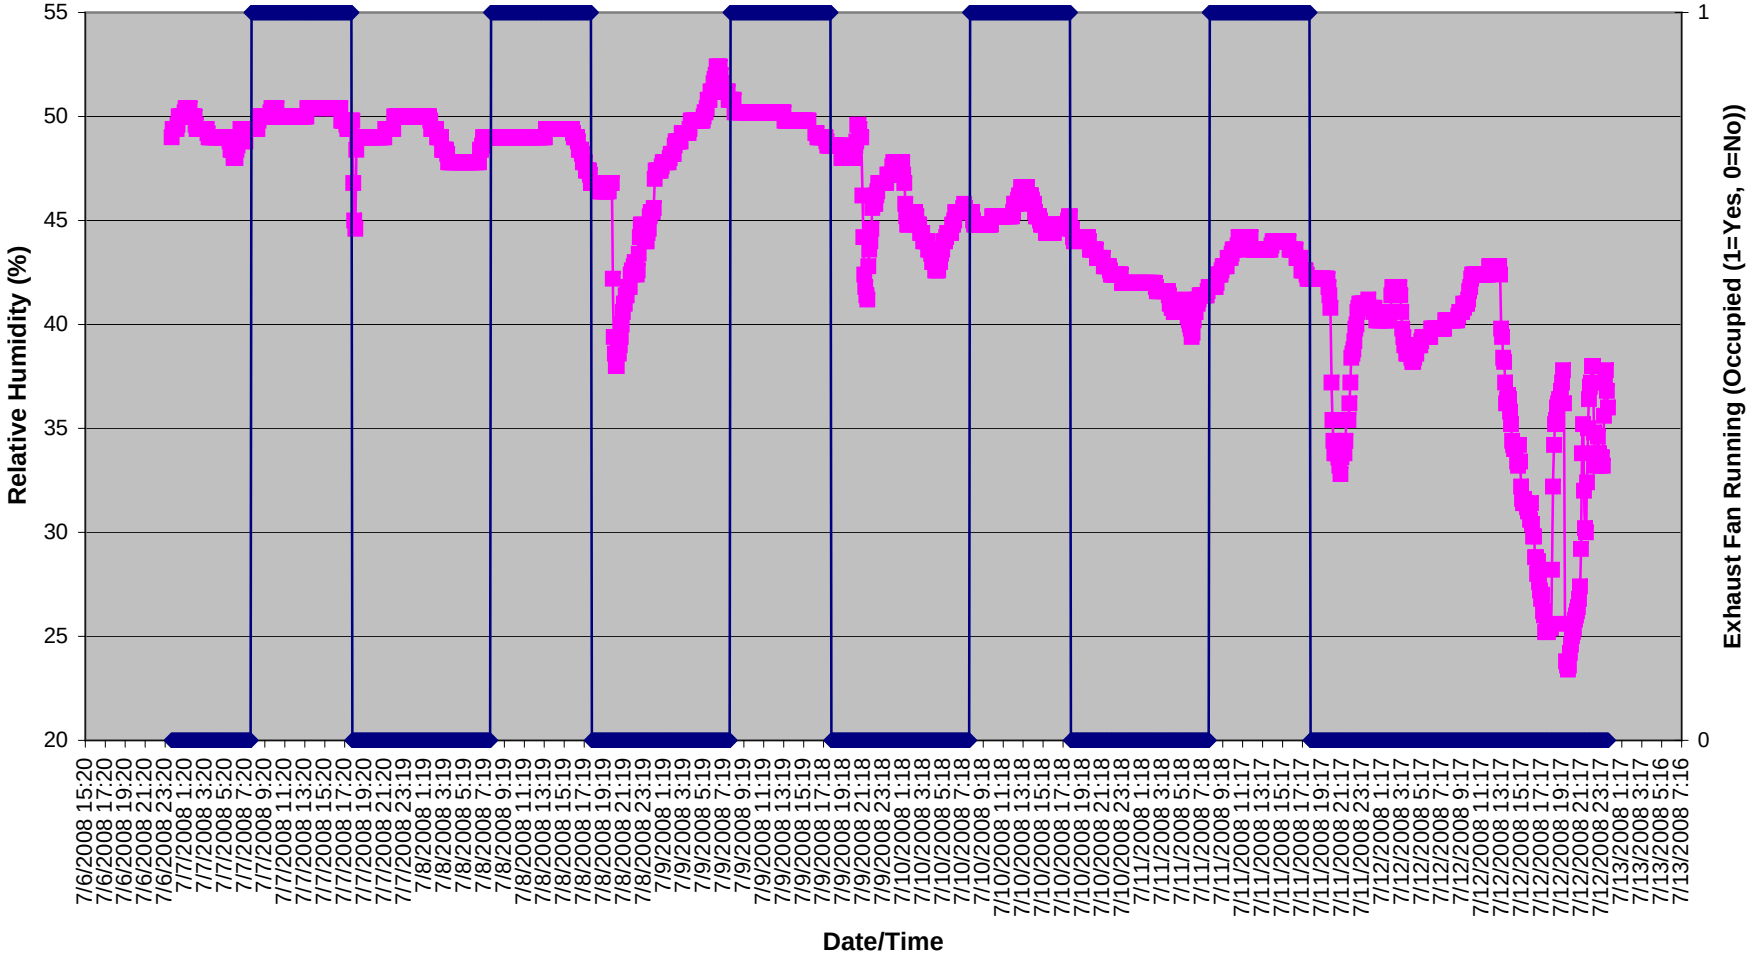

EF1RAHUM.PointValue #REF! #REF! Occupied (1=yes, 0=No)